


TEST:

- Turn the SENS knob clockwise on the maximum. Turn the TIME knob anti-clockwise on the minimum, Turn the LUX knob clockwise on the maximum.
- When you switch on the power, the light will be on at once, and 5-30 seconds later will be off automatically. Then if the sensor receives induction signal, it can work normally.

- After 5-10sec of the first detection, the light could work again. If there is no induction signal, the load should be stopped working within 5-15sec.

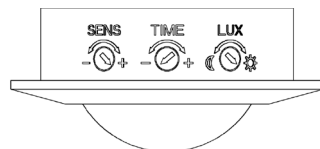

TROUBLE SHOOTING:

The load don't work

1. Check the power and the load.
2. Whether the indicator light is turned on after sensing? If yes, please check load.
3. If the indicator light is not turn on after sensing, please check if the working light corresponds to the ambient light.
4. Please check if the working voltage corresponds to the power source

Poor sensitivity:

1. Please check the ambient temperature.
2. Please check if the signals source is in the detection fields.
3. Please check the installation height.

The sensor can't shut automatically the load:

1. If there are continual signals in the detection fields.
2. If the time delay is set to the longest.
3. If the power corresponds to the instruction.
4. If the air temperature changes near the sensor, air condition or central heating etc..

Note:

When testing in daylight, please turn LUX knob to ☀ (SUN) position, otherwise the luminaire will not work!

DA'SEL

BASIC

DS140 BASIC

Microwave sensor

INSTALLATION AND INSTRUCTIONS

The DA'SEL microwave sensor is a high quality sensor and a cost effective solution for commercial and domestic users in helping reduce energy consumption. Energy savings start as soon as the sensors are installed. The DA'SEL microwave sensor, ensure that

lighting only comes on when required, and most importantly that lighting is switched off when an area is no longer in use.

Detection is possible through doors, panes of glass or thin walls.



DA'SEL DA'SEL, DA'SEL BASIC, DA'SEL STANDARD and DA'SEL PROFESSIONAL are registered trademarks of Energy Conservation Solutions.

* 1 year warranty on DA'SEL BASIC, 2 Years on DA'SEL STANDARD and 5 years on DA'SEL PROFESSIONAL

Energy Conservation Solutions Pty Ltd
Unit 9, 103 Lewis Road, Knoxfield Vic 3180 | Ph 1300 306 136
www.ecs.net.au

SPECIFICATION:

Power Sourcing: 220-240V/AC

HF System: 5.8GHz CW radar, ISM band

Detection Range: 360°

Power Frequency: 50Hz

Ambient Light: 3-2000LUX (Adjustable)

Time-Delay: Min.10sec ± 3sec

Max.12min ± 1min

Installing Height: 1.5m~3.5m

Power Consumption: approx 0.9W

Rated Load: 1200W (incandescent lamp)
300W (energy-saving lamp)



Detection Motion Speed: 0.6~1.5m/s

Detection Distance: 1-10m (radius)

FUNCTION:

- Identifies day and night: It can work in the daytime and at night when it is adjusted to the "sun" position (max). It can work in the ambient light less than 3LUX when it is adjusted to the "moon" position (min). As for the adjustment pattern, please refer to the testing pattern.
- SENS adjustable: It can be adjusted according to using location; low sensitivity with 1m for detection distance; High sensitivity with 8m, it fits for large room.
- Time-Delay is added continually: When it receives the second induction signals after the first induction, it will compute time once more on the basis of the first time-delay rest.

- Time-Delay is adjustable. It can be set according to the consumer's desire. The minimum time is 10sec±3sec. The maximum is 12min±1min.




NOTE: the high-frequency output of this sensor is <10mW- that is just one 100th of the transmission power of a mobile phone or the output of a microwave oven.

INSTALLATION:


(Refer installation diagram on the right)

- Switch off the power.
- Open the transparent vinyl cover, which is at the bottom of the sensor.
- Loosening the screws in the connection terminal, connecting the power and rated load to connection terminal of sensor according to connection sketch map.
- Tighten the screws; put the transparent vinyl cover into the original location
- Folding the metal spring of the sensor upwards, until they are in "I" position with sensor, then put the sensor into the hole or installation box which is on the ceiling, the size is similar to item. Releasing the spring, the sensor will be set in this installation position.
- After finishing installing, the sensor could be connected to the power and tested.

INSTALLATION AND INSTRUCTIONS

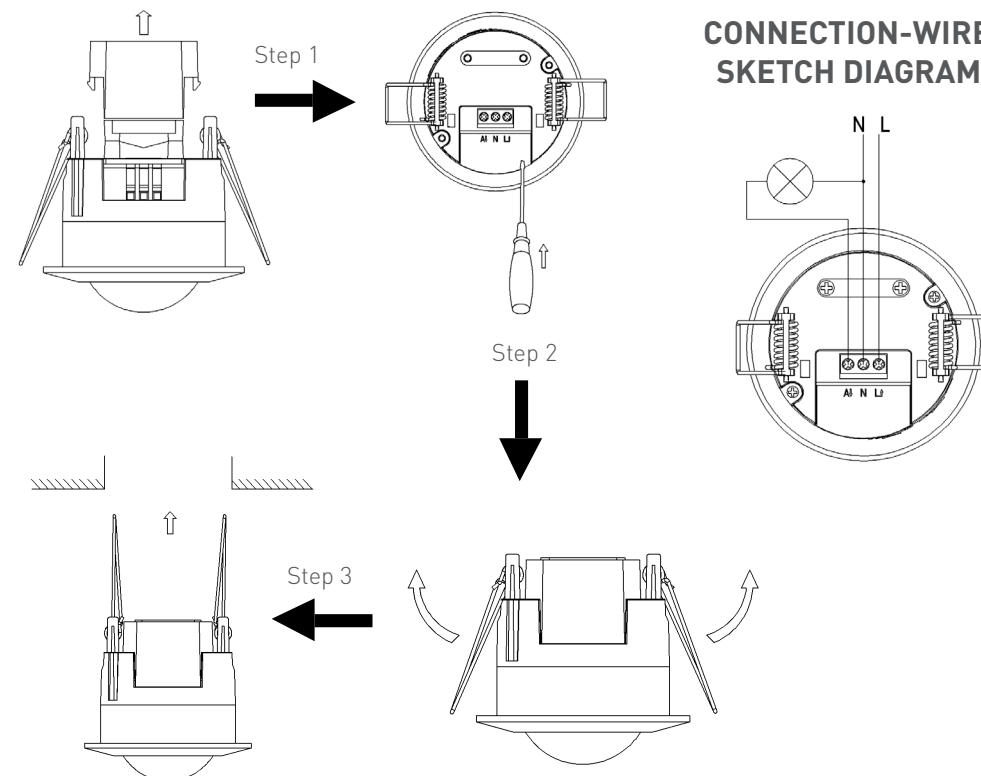

CONNECTION-WIRE SKETCH DIAGRAM:

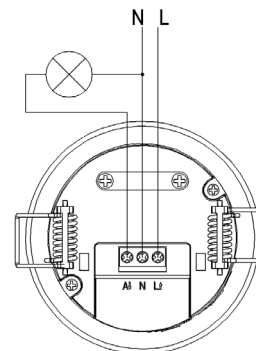

NOTE:

- The unrest objects can't be regarded as the installation basis-face.
- In front of the detection window there shouldn't be hinder or unrest objects affecting detection.
- Avoid installing it near air temperature alteration zones for example: air condition, central heating, etc.
- In order to avoid the unexpected damage of product, please add a safe device of 6A when installing microwave sensor, for example, fuse, safe tube etc.